

Name [REDACTED]



Central\_24\_2 Threshold

Eye: OD


Strategy: Interactive Fast Threshold  
Fixation Target: Bilateral  
Fixation Monitor: Blind Spot Test  
Questions Asked: 194  
Test Duration: 4:40  
Fixation Losses: 5/8

Stm Size: 3  
Stm Color: White  
Bkg DB: 34  
Bkg Color: White  
Fov DB: 25.5  
False Positive: 1/8

DOB [REDACTED]  
ID: 27655  
Date: 2025-02-12  
Time: 14:02:45  
VA: 20/20  
False Negative: 0/8

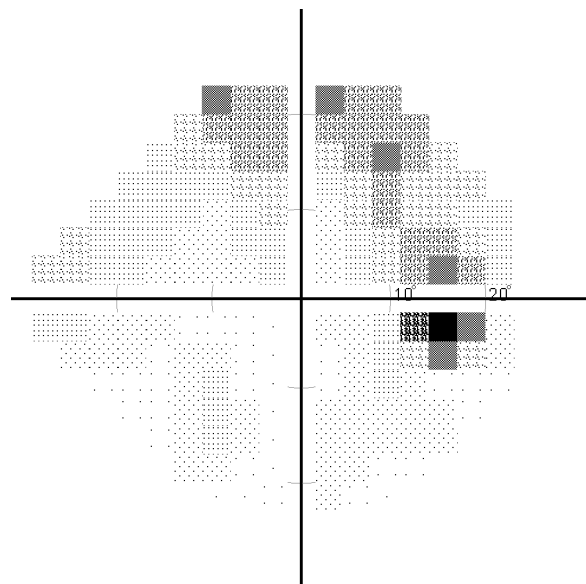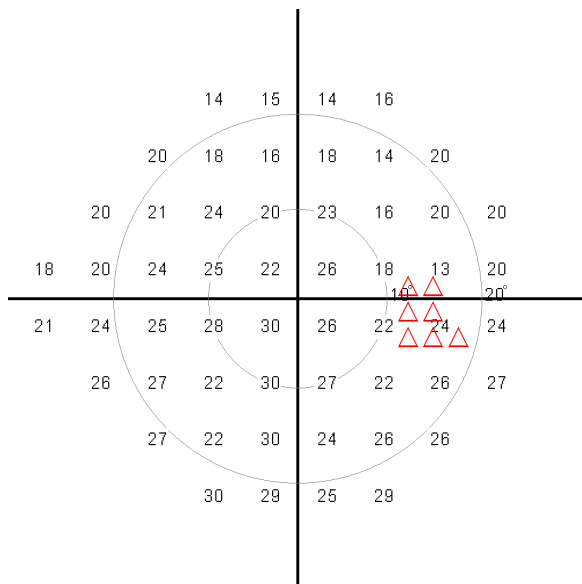


MD Progression(DB)

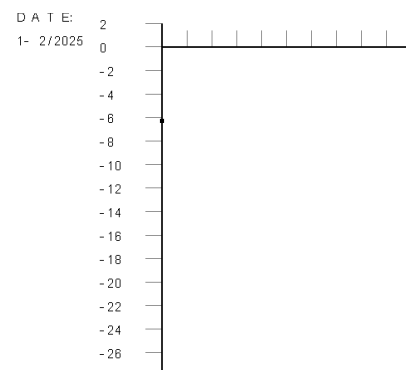


MD SLOPE = NN DB/YEAR

Total Deviation

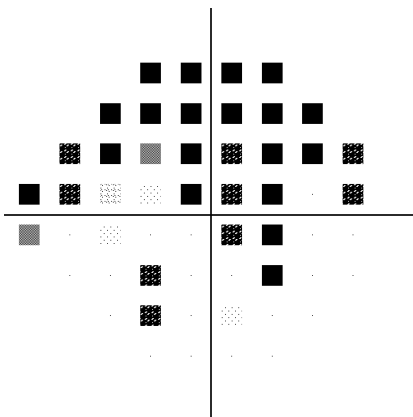

GHT: Outside Normal Limits

Pattern Deviation

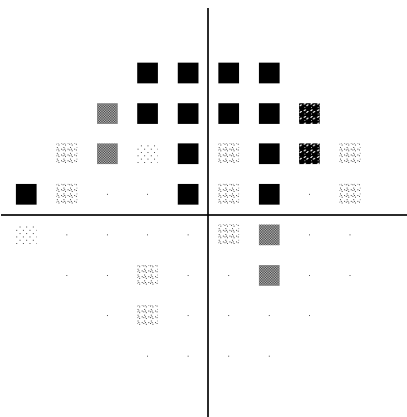

Reliability: Med

MD: -6.28 DB  
PSD: 4.38 DB  
MS: 22.41 DB  
VFI: 78%  
Vision Loss: 22%

< 0.5%  
< 1%  
< 2%  
< 5%  
< 10%

KeyPress Time